




INDOOR AIR QUALITY CERTIFICATE

(ISO 14644-1 CLASS 8)

This certificate is to certify that the indoor air quality in the following locations is complete and complies with ISO 14644-1 Class 8.

Client :
Address :
Tested Areas : DATA HALL 13
Number of Sample tested : 30
Particle counter used : Lighthouse Hand Held particle counter 3016 IAQ
Serial Number – 170444004 Sensor ID – 170402-010
Calibrated on 28th June 2024

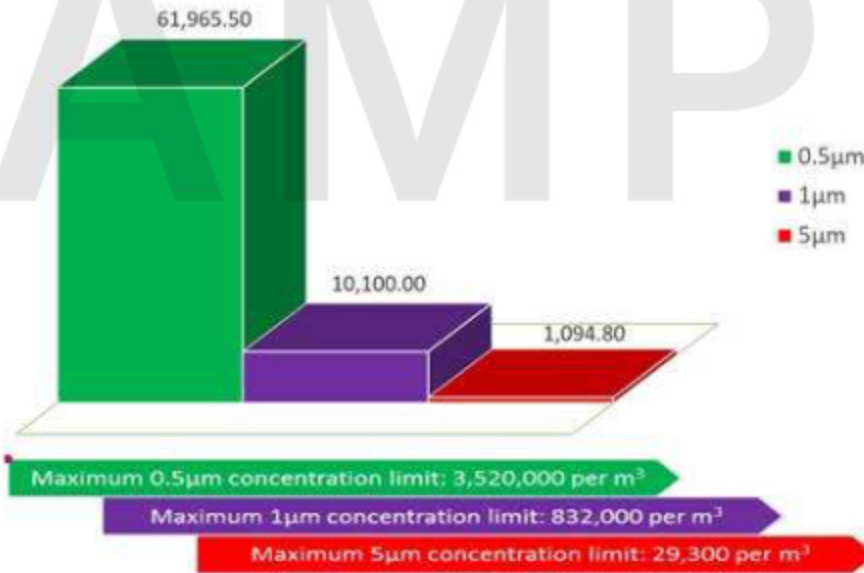

The purpose of the testing program is to monitor the performance of a facility in order to identify significant changes in efficiency. This process will ensure that the changes can be addressed before they become a major source of contamination effecting productivity and yield.



Certification date: 31st of August 2024
Next sample testing due date: 30th of August 2025